

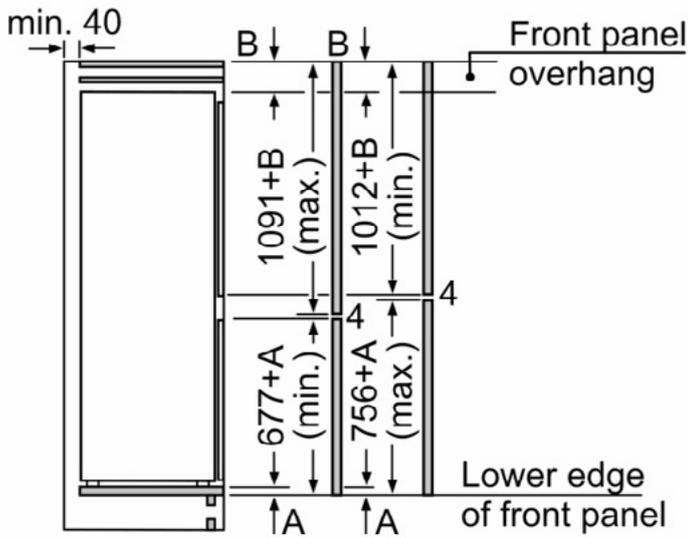


measurements in mm

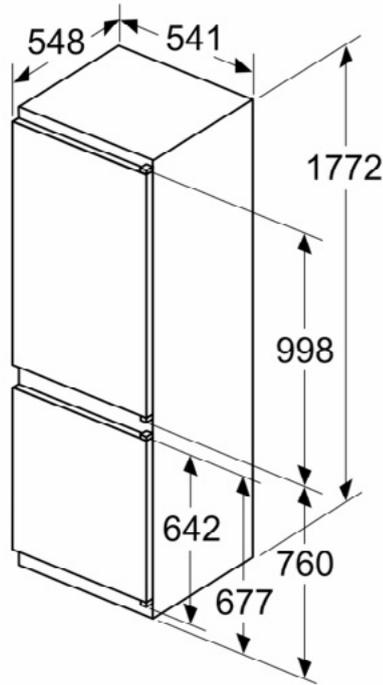


Air outlet
min. 200 cm²

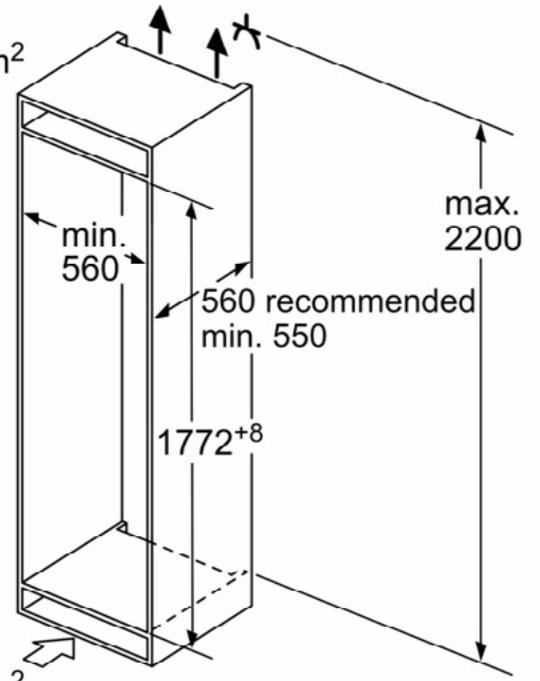

The specified unit door dimensions are valid for a door gap of 4 mm.

measurements in mm

measurements in mm

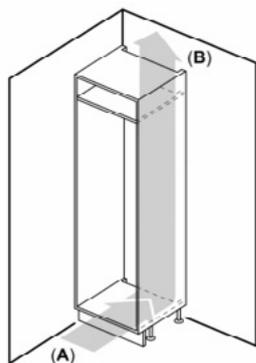

A: Air inlet ≥ 200 cm²; Ventilation options
B: Air outlet ≥ 200 cm²; Ventilation options

